



GRIDLINE F

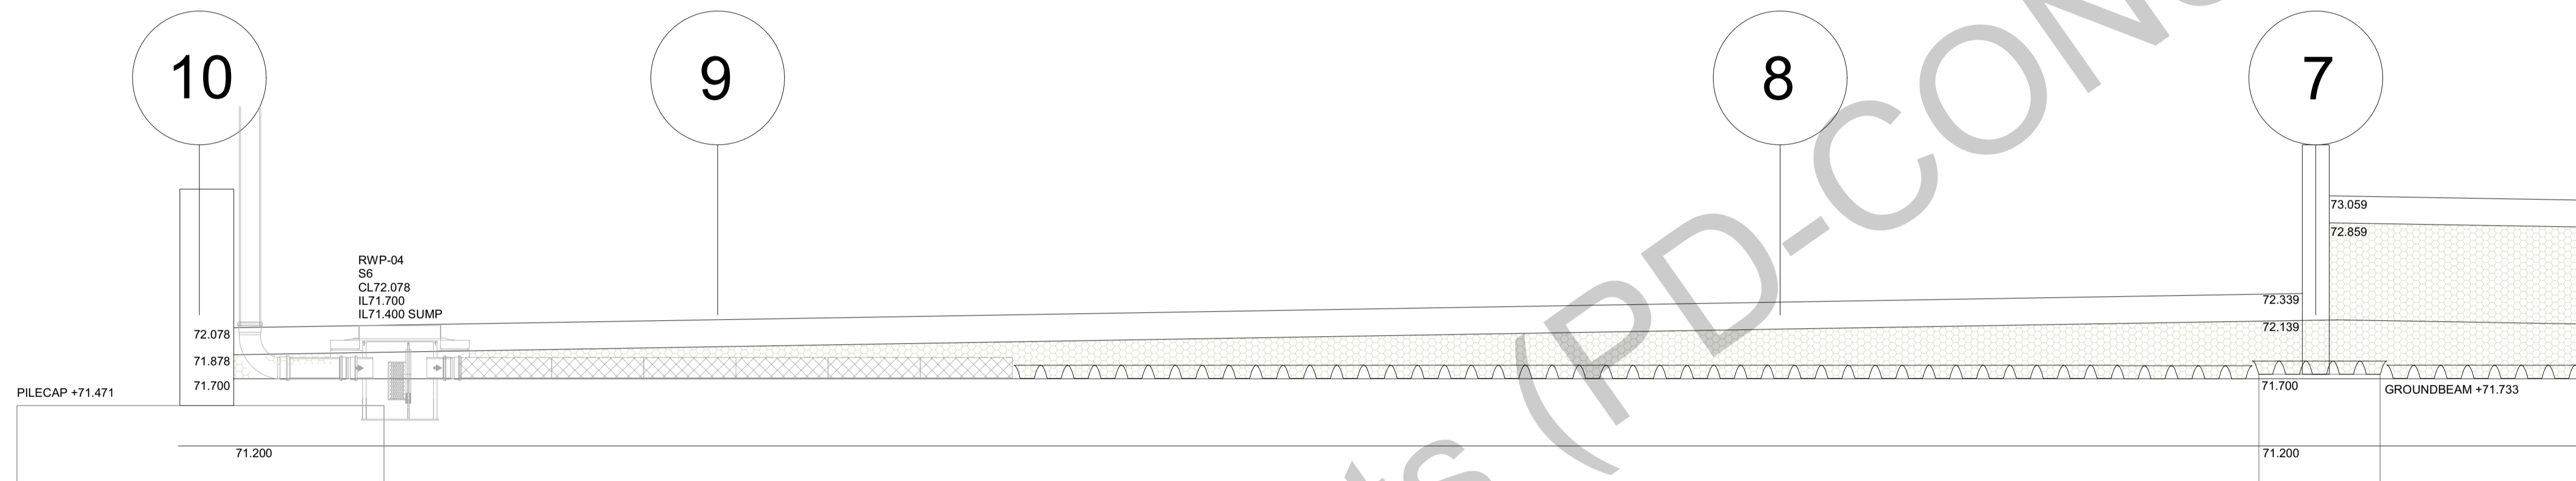

GRIDLINE J/K

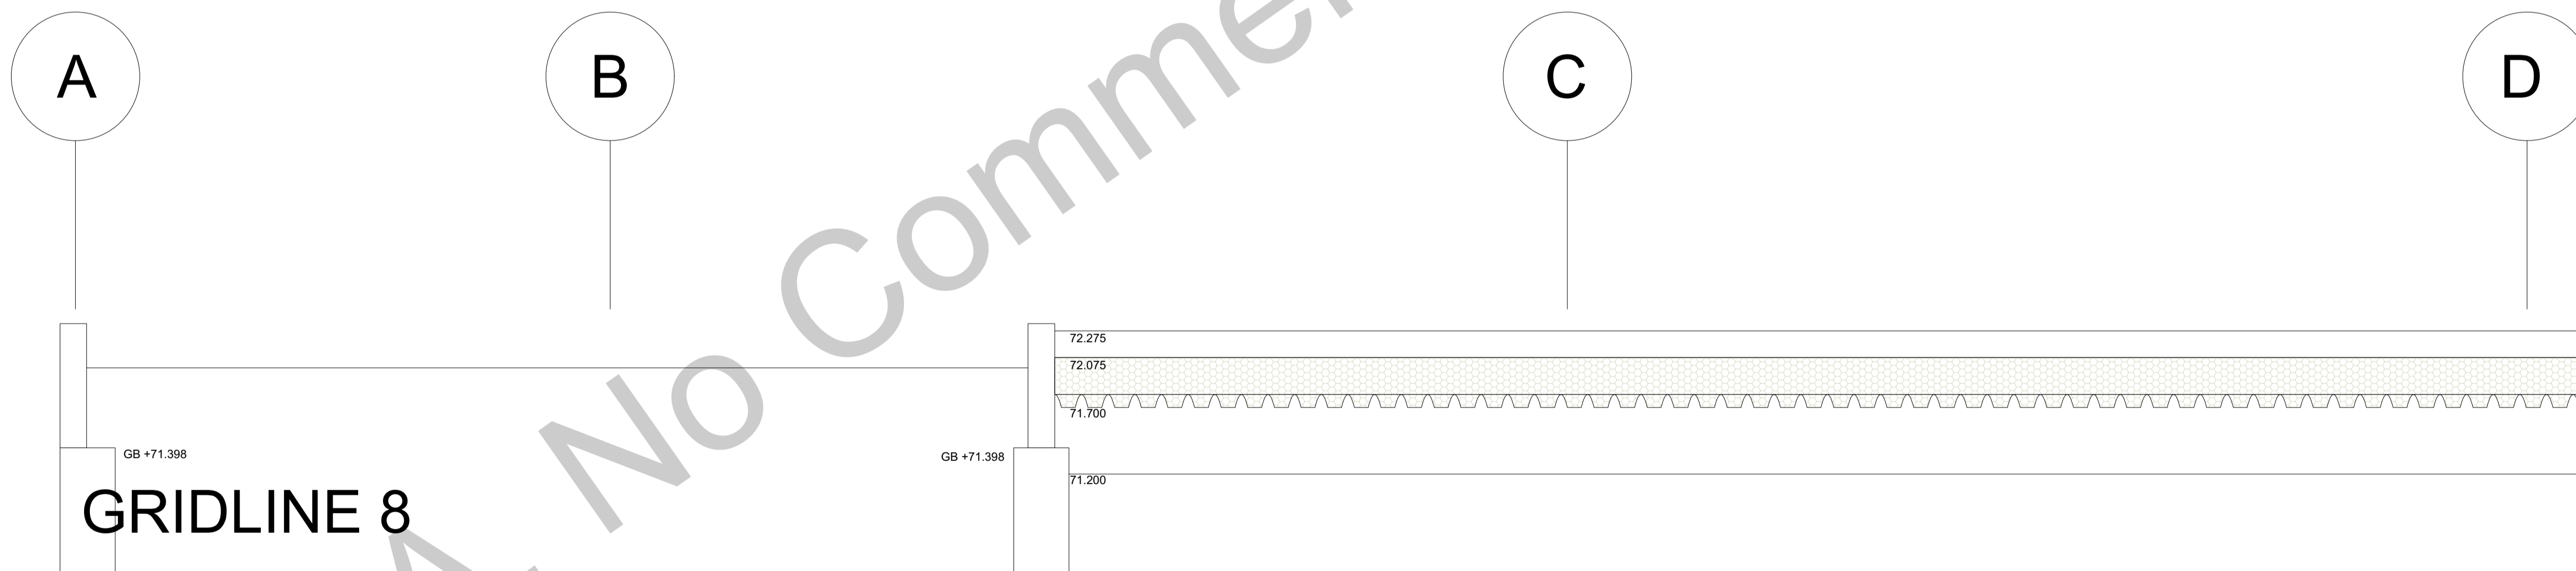

GRIDLINE 8

**NOTES**

**GENERAL**  
 This drawing is to be read in conjunction with all relevant Engineers and Architects drawings.  
 For setting out refer to Architects drawings.  
 All dimensions are in millimetres and levels are in metres unless noted otherwise.  
 Contractor to take all relevant dimensions on site.  
 Any discrepancies to be advised to the Engineer.  
 Contractor to check/scan for services prior to construction to avoid any damage during works.

**DRAINAGE**  
 Any information given on this drawing regarding existing services is believed to be correct.  
 The contractor must check this information and determine the nature and location of other existing services from the various statutory authorities before commencing excavation works.  
 Drainage works to be constructed in accordance with BS EN 752 and Approved Document H.  
 All soft spots and unacceptable material encountered in drainage excavations is to be removed and replaced with granular material to the requirements of the building control officer.  
 Pipes to be installed to manufacturers recommendations.  
 Pipes under buildings to be laid to a fall of 1:40 minimum unless noted otherwise.  
 Plastic plain wall pipes to be PVC-U to BS EN 1401-1, class SN4, with flexible joints, Kitemark certified. Structured wall plastic pipes to be to WIS 04-35-01, Kitemark certified.  
 Clay pipes to be vitrified clay to BS EN 285-1, with flexible joints, Kitemark certified. Clayware pipes must be extra strength classification protected in accordance with the specified details.  
 Bedding of pipes to be in accordance with approved document H1.  
 Rocker pipes with flexible joints are to be provided at a distance of 150mm and 750mm from the face of construction to manholes, where pipes pass above, below or through ground beams or foundations; at gully connections and soil stack ends.  
 Manhole access covers are to be located at the outgoing side of manholes.  
 Cover levels are to be fixed on site to suit finished levels. Covers and frames to BS EN124, Grade D to be used in areas subject to heavy vehicular loading, Grade C in areas subject to light vehicular loading and Grade B to be used elsewhere.

REV.	DESCRIPTION	DATE	DRW.	CHK.
C01	Sections updated & extended over more drawings	18/10/22	MG	ABS
P02	Section added thro pipe run from MSCP to Ex.MH	30/07/22	MG	ABS
P01	First issue	16/06/22	MG	ABS



**Sel Environmental Ltd**  
 Real Innovation  
 SEL Environmental Ltd  
 Canal House  
 Bonsall Street  
 Blackburn  
 BB2 4DD  
 Tel: 01254 589987  
 www.sel.co.uk

PROJECT  
 North Manchester General Hospital

TITLE  
 MSCP Surface Water Attenuation  
 Details, sheet 1 of 6


STATUS  
 S4  
 PURPOSE OF ISSUE  
 For Construction

DRAWN BY  
 MG  
 CHECKED BY  
 JS  
 DATE  
 16/06/2022

SCALE (@A1)  
 NTS  
 PROJECT NUMBER  
 20200 MSCP

FILE DRAWING NUMBER  
 20200-SEL-NM110-EX-DR-Y-0012  
 REV.  
 C01

FOR CONTINUATION  
 20200-SEL-NM110-EX-DR-Y-0015

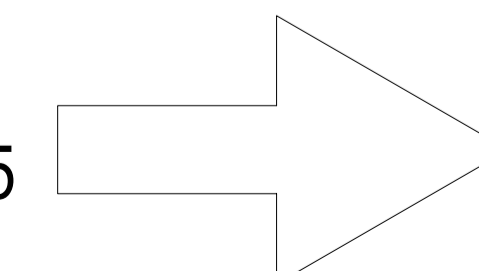


Status A, No Comments (PD-CONSTRUCTION)







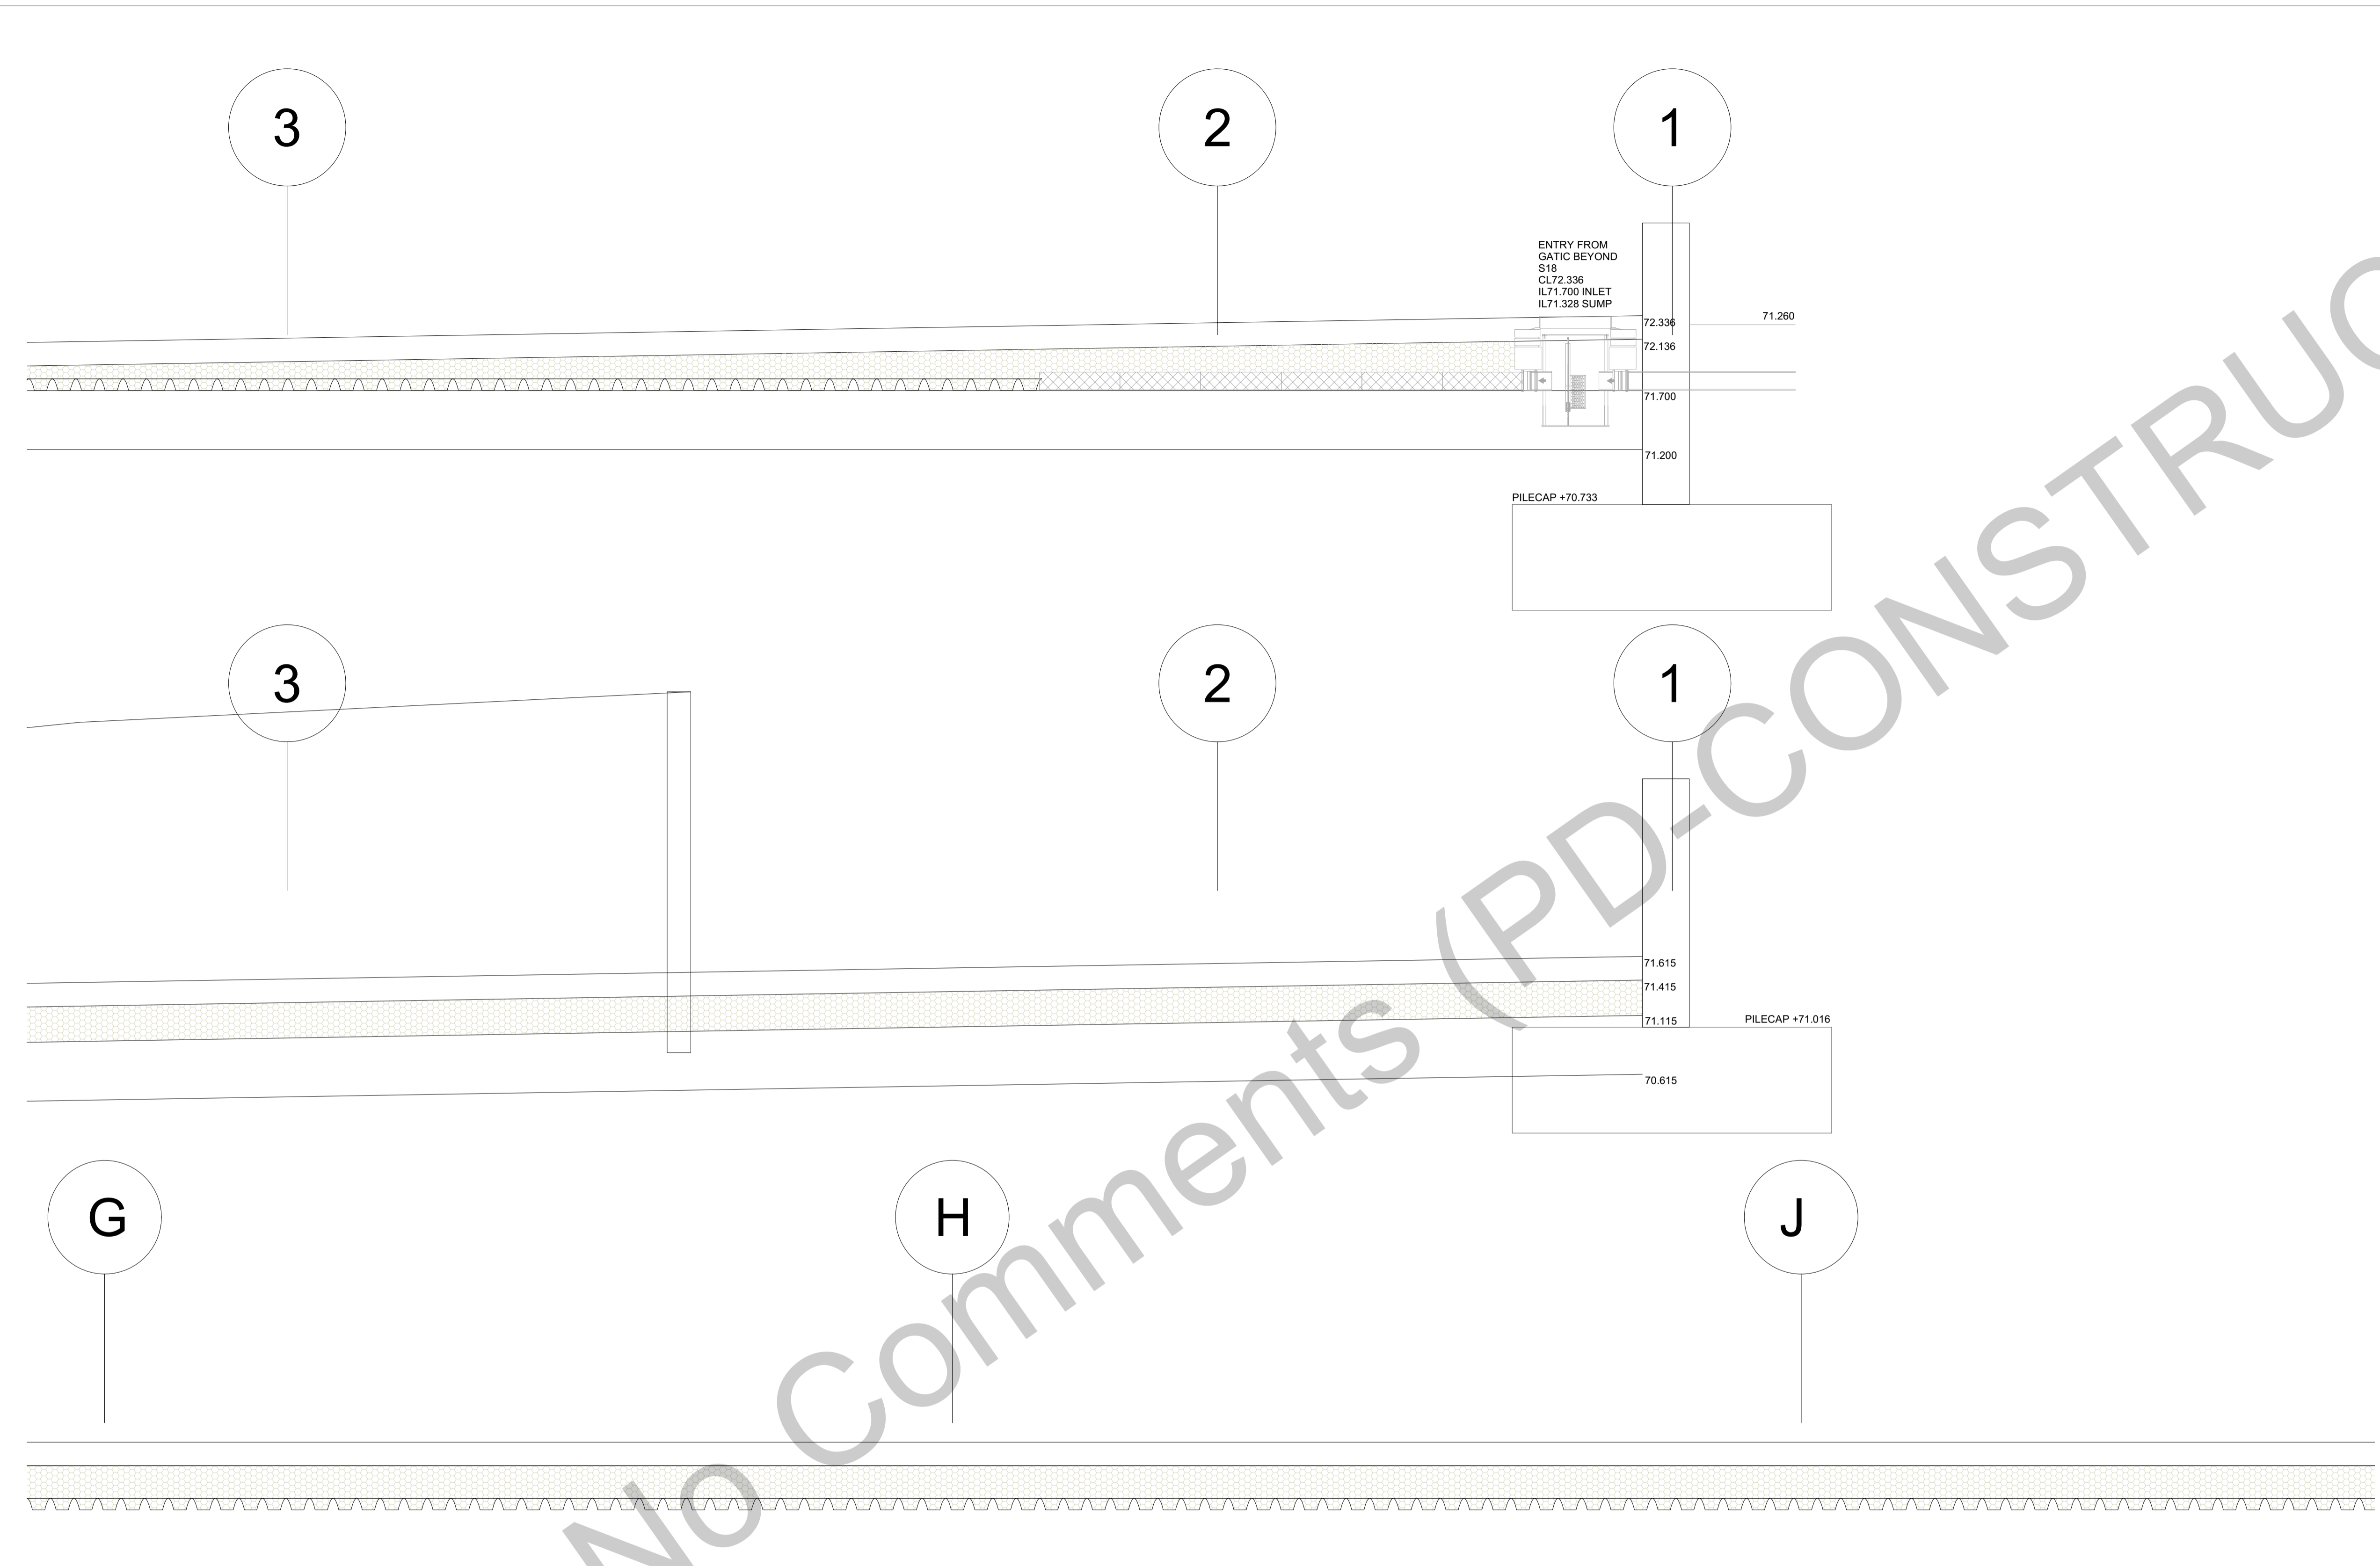

NOTES

GENERAL  
This drawing is to be read in conjunction with all relevant Engineers and Architects drawings.  
For setting out refer to Architects drawings.  
All dimensions are in millimetres and levels are in metres unless noted otherwise.  
Contractor to take all relevant dimensions on site.  
Any discrepancies to be advised to the Engineer.  
Contractor to check/scan for services prior to construction to avoid any damage during works.

DRAINAGE  
Any information given on this drawing regarding existing services is believed to be correct.  
The contractor must check this information and determine the nature and location of other existing services from the various statutory authorities before commencing excavation works.  
Drainage works to be constructed in accordance with BS EN 752 and Approved Document H.  
All soft spots and unacceptable material encountered in drainage excavations is to be removed and replaced with granular material to the requirements of the building control officer.  
Pipes to be installed to manufacturers recommendations.  
Pipes under buildings to be laid to a fall of 1:40 minimum unless noted otherwise.  
Plastic plain wall pipes to be PVC-U to BS EN 1401-1, class SN4, with flexible joints, Kitemark certified. Structured wall plastic pipes to be to WIS 04-35-01, Kitemark certified.  
Clay pipes to be vitrified clay to BS EN 285-1, with flexible joints, Kitemark certified. Clayware pipes must be extra strength classification protected in accordance with the specified details.  
Bedding of pipes to be in accordance with approved document H1.  
Rocker pipes with flexible joints are to be provided at a distance of 150mm and 750mm from the face of construction to manholes, where pipes pass above, below or through ground beams or foundations; at gully connections and soil stack ends.  
Manhole access covers are to be located at the outgoing side of manholes.  
Cover levels are to be fixed on site to suit finished levels. Covers and frames to BS EN124, Grade D to be used in areas subject to heavy vehicular loading, Grade C in areas subject to light vehicular loading and Grade B to be used elsewhere.

REV.	DESCRIPTION	DATE	DRW.	CHK.
C01	First issue	18/10/2022	MG	ABS



**Sel Environmental Ltd**  
Real Innovation  
SEL Environmental Ltd  
Canal House  
Bonsall Street  
Blackburn  
BB2 4DD  
Tel: 01254 589987  
www.sel.co.uk

PROJECT  
North Manchester General Hospital



TITLE  
MSCP Surface Water Attenuation  
Details, sheet 3 of 6

STATUS S4	PURPOSE OF ISSUE For Construction		
DRAWN BY MG	CHECKED BY JS	DATE 18/10/2022	
SCALE (@A1) NTS	PROJECT NUMBER 20200 MSCP		
FILE DRAWING NUMBER 20200-SEL-NM110-EX-DR-Y-0016			REV. C01

FOR CONTINUATION  
20200-SEL-NM110-EX-DR-Y-0015

FOR CONTINUATION  
20200-SEL-NM110-EX-DR-Y-0017

GRIDLINE 8

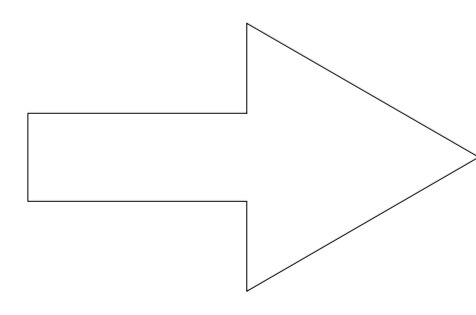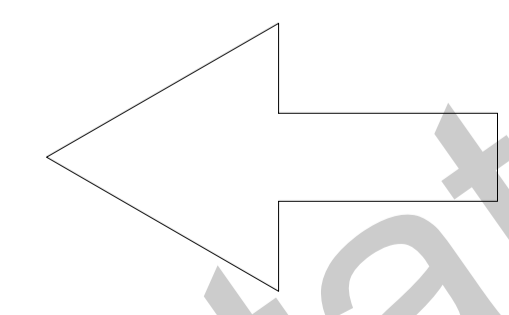

J

K

L

L

M

N


P

P

8

# GRIDLINE 8

# GRIDLINE 8

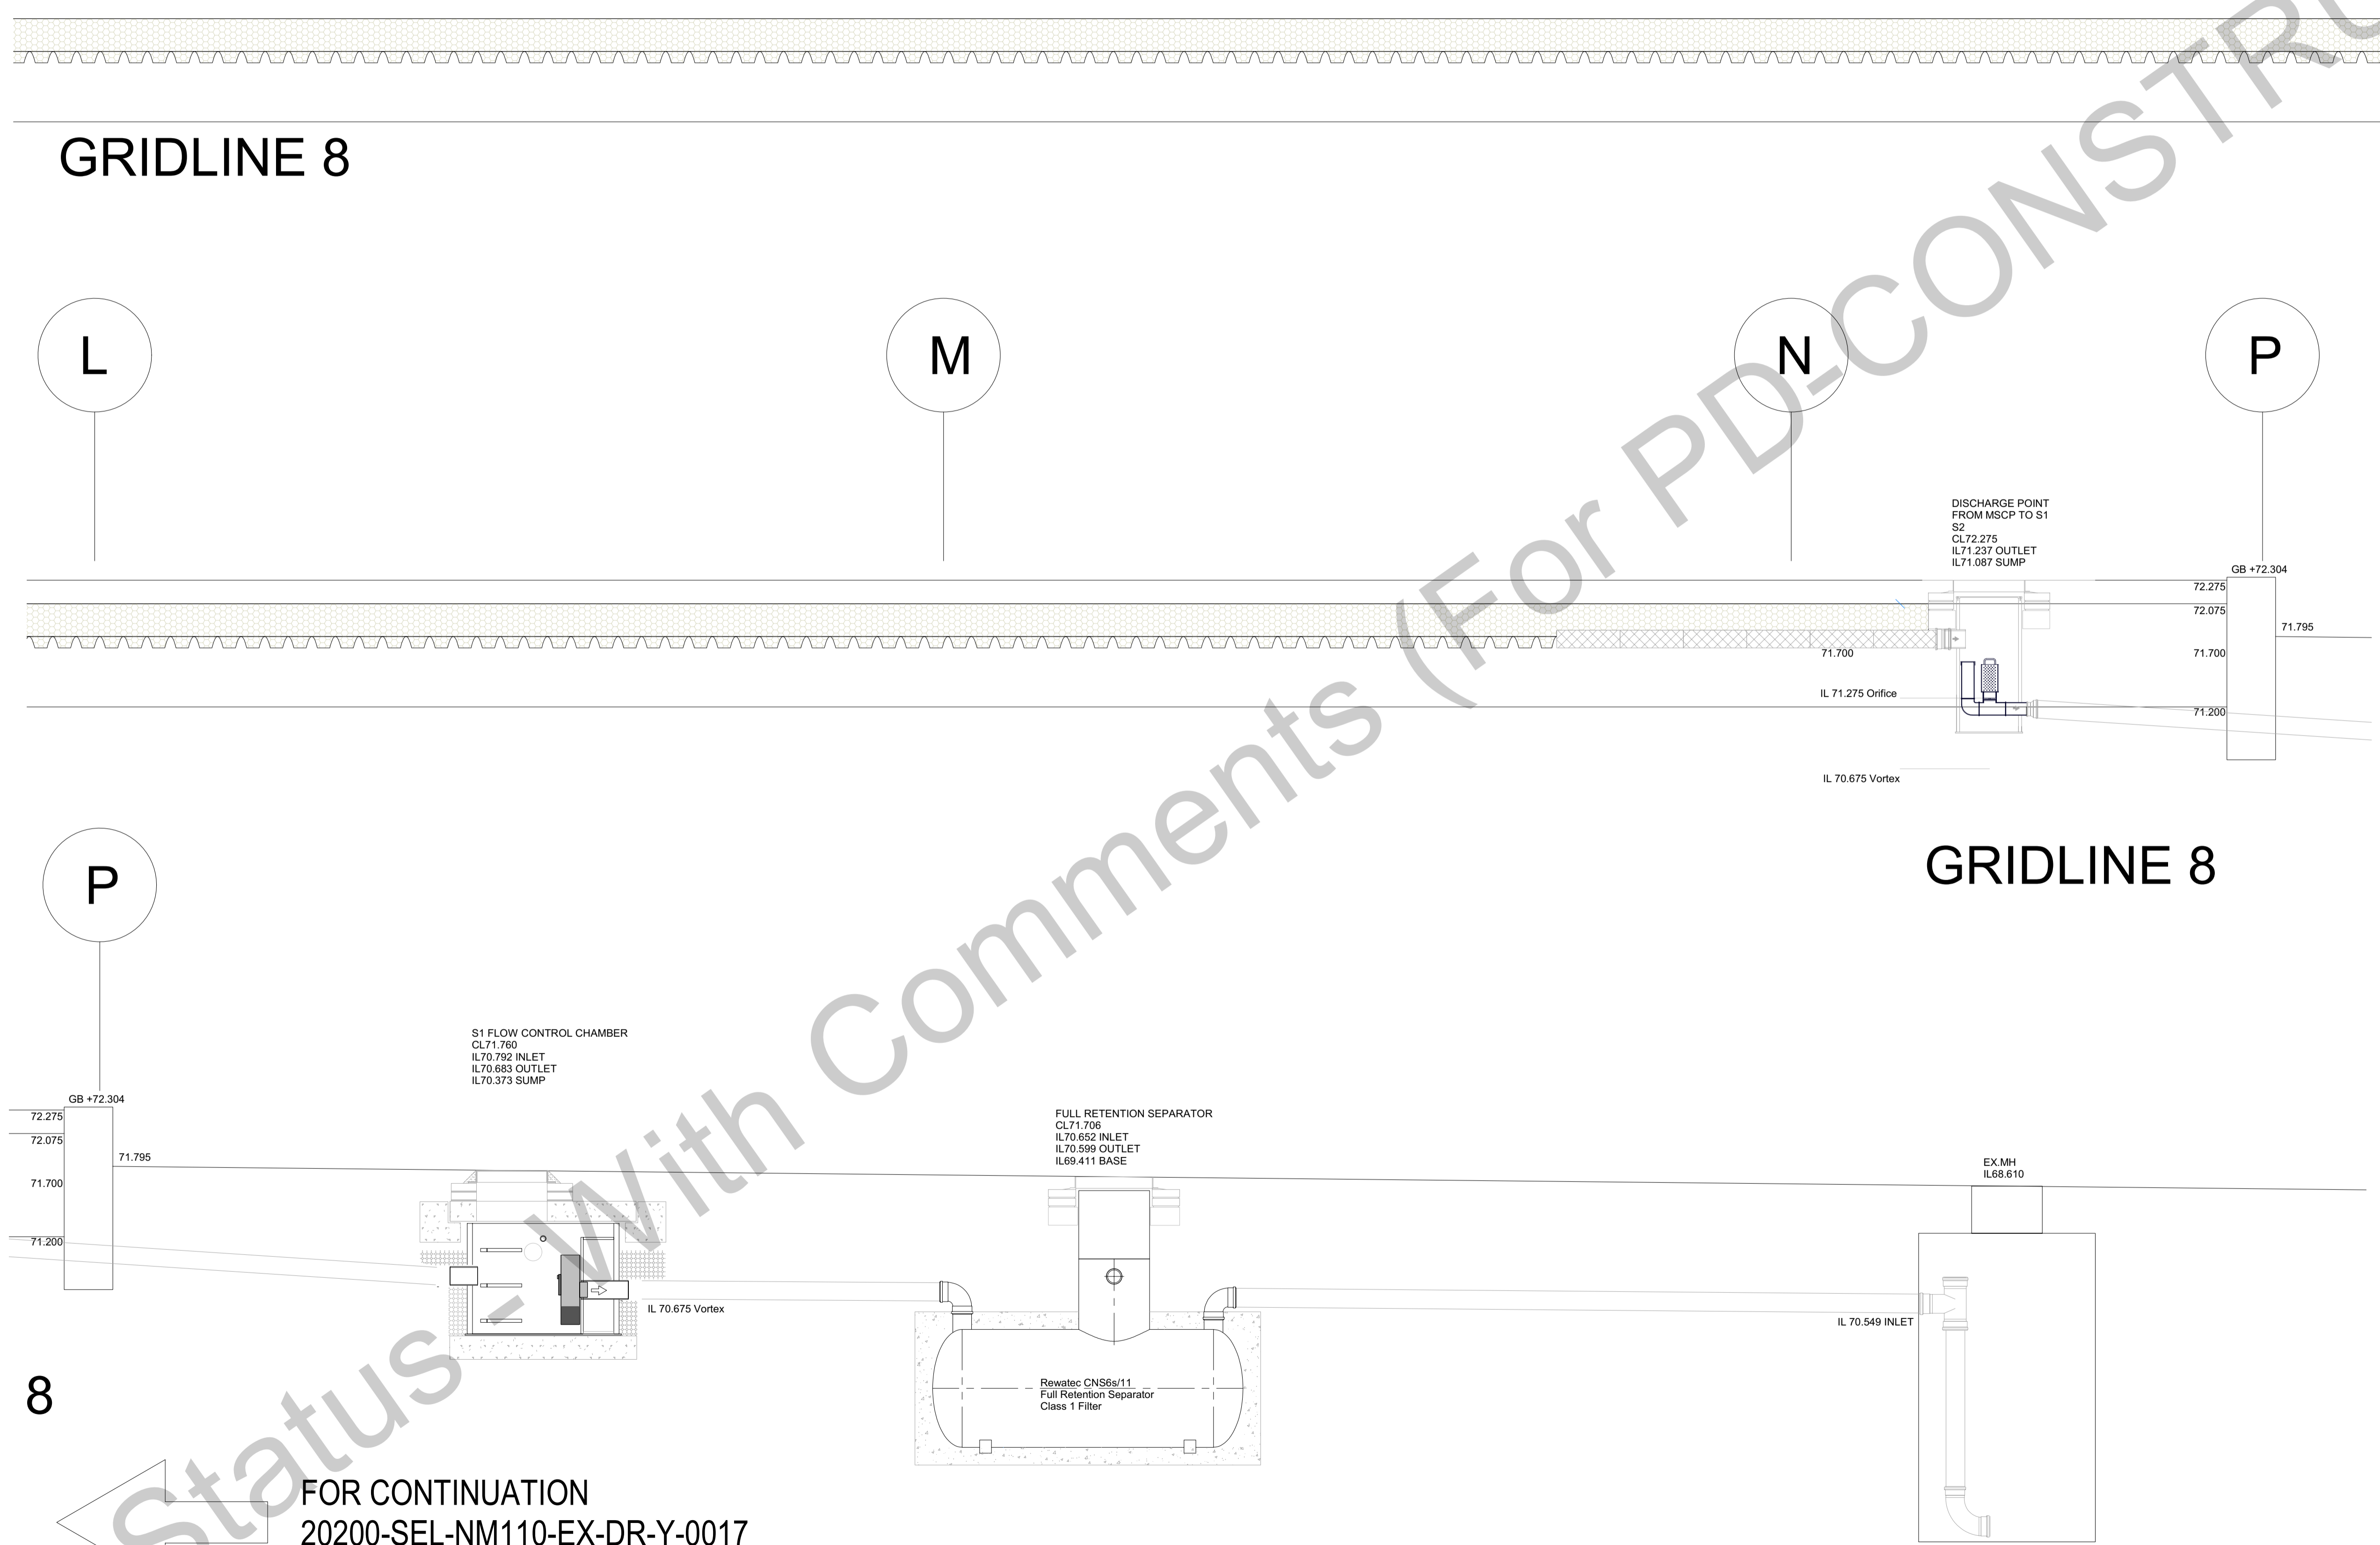

NOTES

GENERAL  
This drawing is to be read in conjunction with all relevant Engineers and Architects drawings.  
For setting out refer to Architects drawings.  
All dimensions are in millimetres and levels are in metres unless noted otherwise.  
Contractor to take all relevant dimensions on site.  
Any discrepancies to be advised to the Engineer.  
Contractor to check/scan for services prior to construction to avoid any damage during works.

DRAINAGE  
Any information given on this drawing regarding existing services is believed to be correct.  
The contractor must check this information and determine the nature and location of other existing services from the various statutory authorities before commencing excavation works.  
Drainage works to be constructed in accordance with BS EN 752 and Approved Document H.  
All soft spots and unacceptable material encountered in drainage excavations is to be removed and replaced with granular material to the requirements of the building control officer.  
Pipes to be installed to manufacturers recommendations.  
Pipes under buildings to be laid to a fall of 1:40 minimum unless noted otherwise.  
Plastic plain wall pipes to be PVC-U to BS EN 1401-1, class SN4, with flexible joints, Kitemark certified. Structured wall plastic pipes to be to WIS 04-35-01, Kitemark certified.  
Clay pipes to be vitrified clay to BS EN 285-1, with flexible joints, Kitemark certified. Clayware pipes must be extra strength classification protected in accordance with the specified details.  
Bedding of pipes to be in accordance with approved document H1.  
Rocker pipes with flexible joints are to be provided at a distance of 150mm and 750mm from the face of construction to manholes, where pipes pass above, below or through ground beams or foundations; at gully connections and soil stack ends.  
Manhole access covers are to be located at the outgoing side of manholes.  
Cover levels are to be fixed on site to suit finished levels. Covers and frames to BS EN124, Grade D to be used in areas subject to heavy vehicular loading, Grade C in areas subject to light vehicular loading and Grade B to be used elsewhere.

REV.	DESCRIPTION	DATE	DRW.	CHK.
C01	First issue	18/10/2022	MG	ABS

**NHS**  
Manchester University  
NHS Foundation Trust

**Sel Environmental Ltd**  
Real Innovation  
SEL Environmental Ltd  
Canal House  
Bonsall Street  
Blackburn  
BB2 4DD  
Tel: 01254 589987  
www.sel.co.uk

PROJECT  
North Manchester General Hospital


TITLE  
MSCP Surface Water Attenuation  
Details, sheet 4 of 6

STATUS S4	PURPOSE OF ISSUE For Construction	
DRAWN BY MG	CHECKED BY JS	DATE 18/10/2022
SCALE (@A1) NTS	PROJECT NUMBER 20200 MSCP	

FILE DRAWING NUMBER 20200-SEL-NM110-EX-DR-Y-0017	REV. C01
---	-------------

FOR CONTINUATION  
20200-SEL-NM110-EX-DR-Y-0017



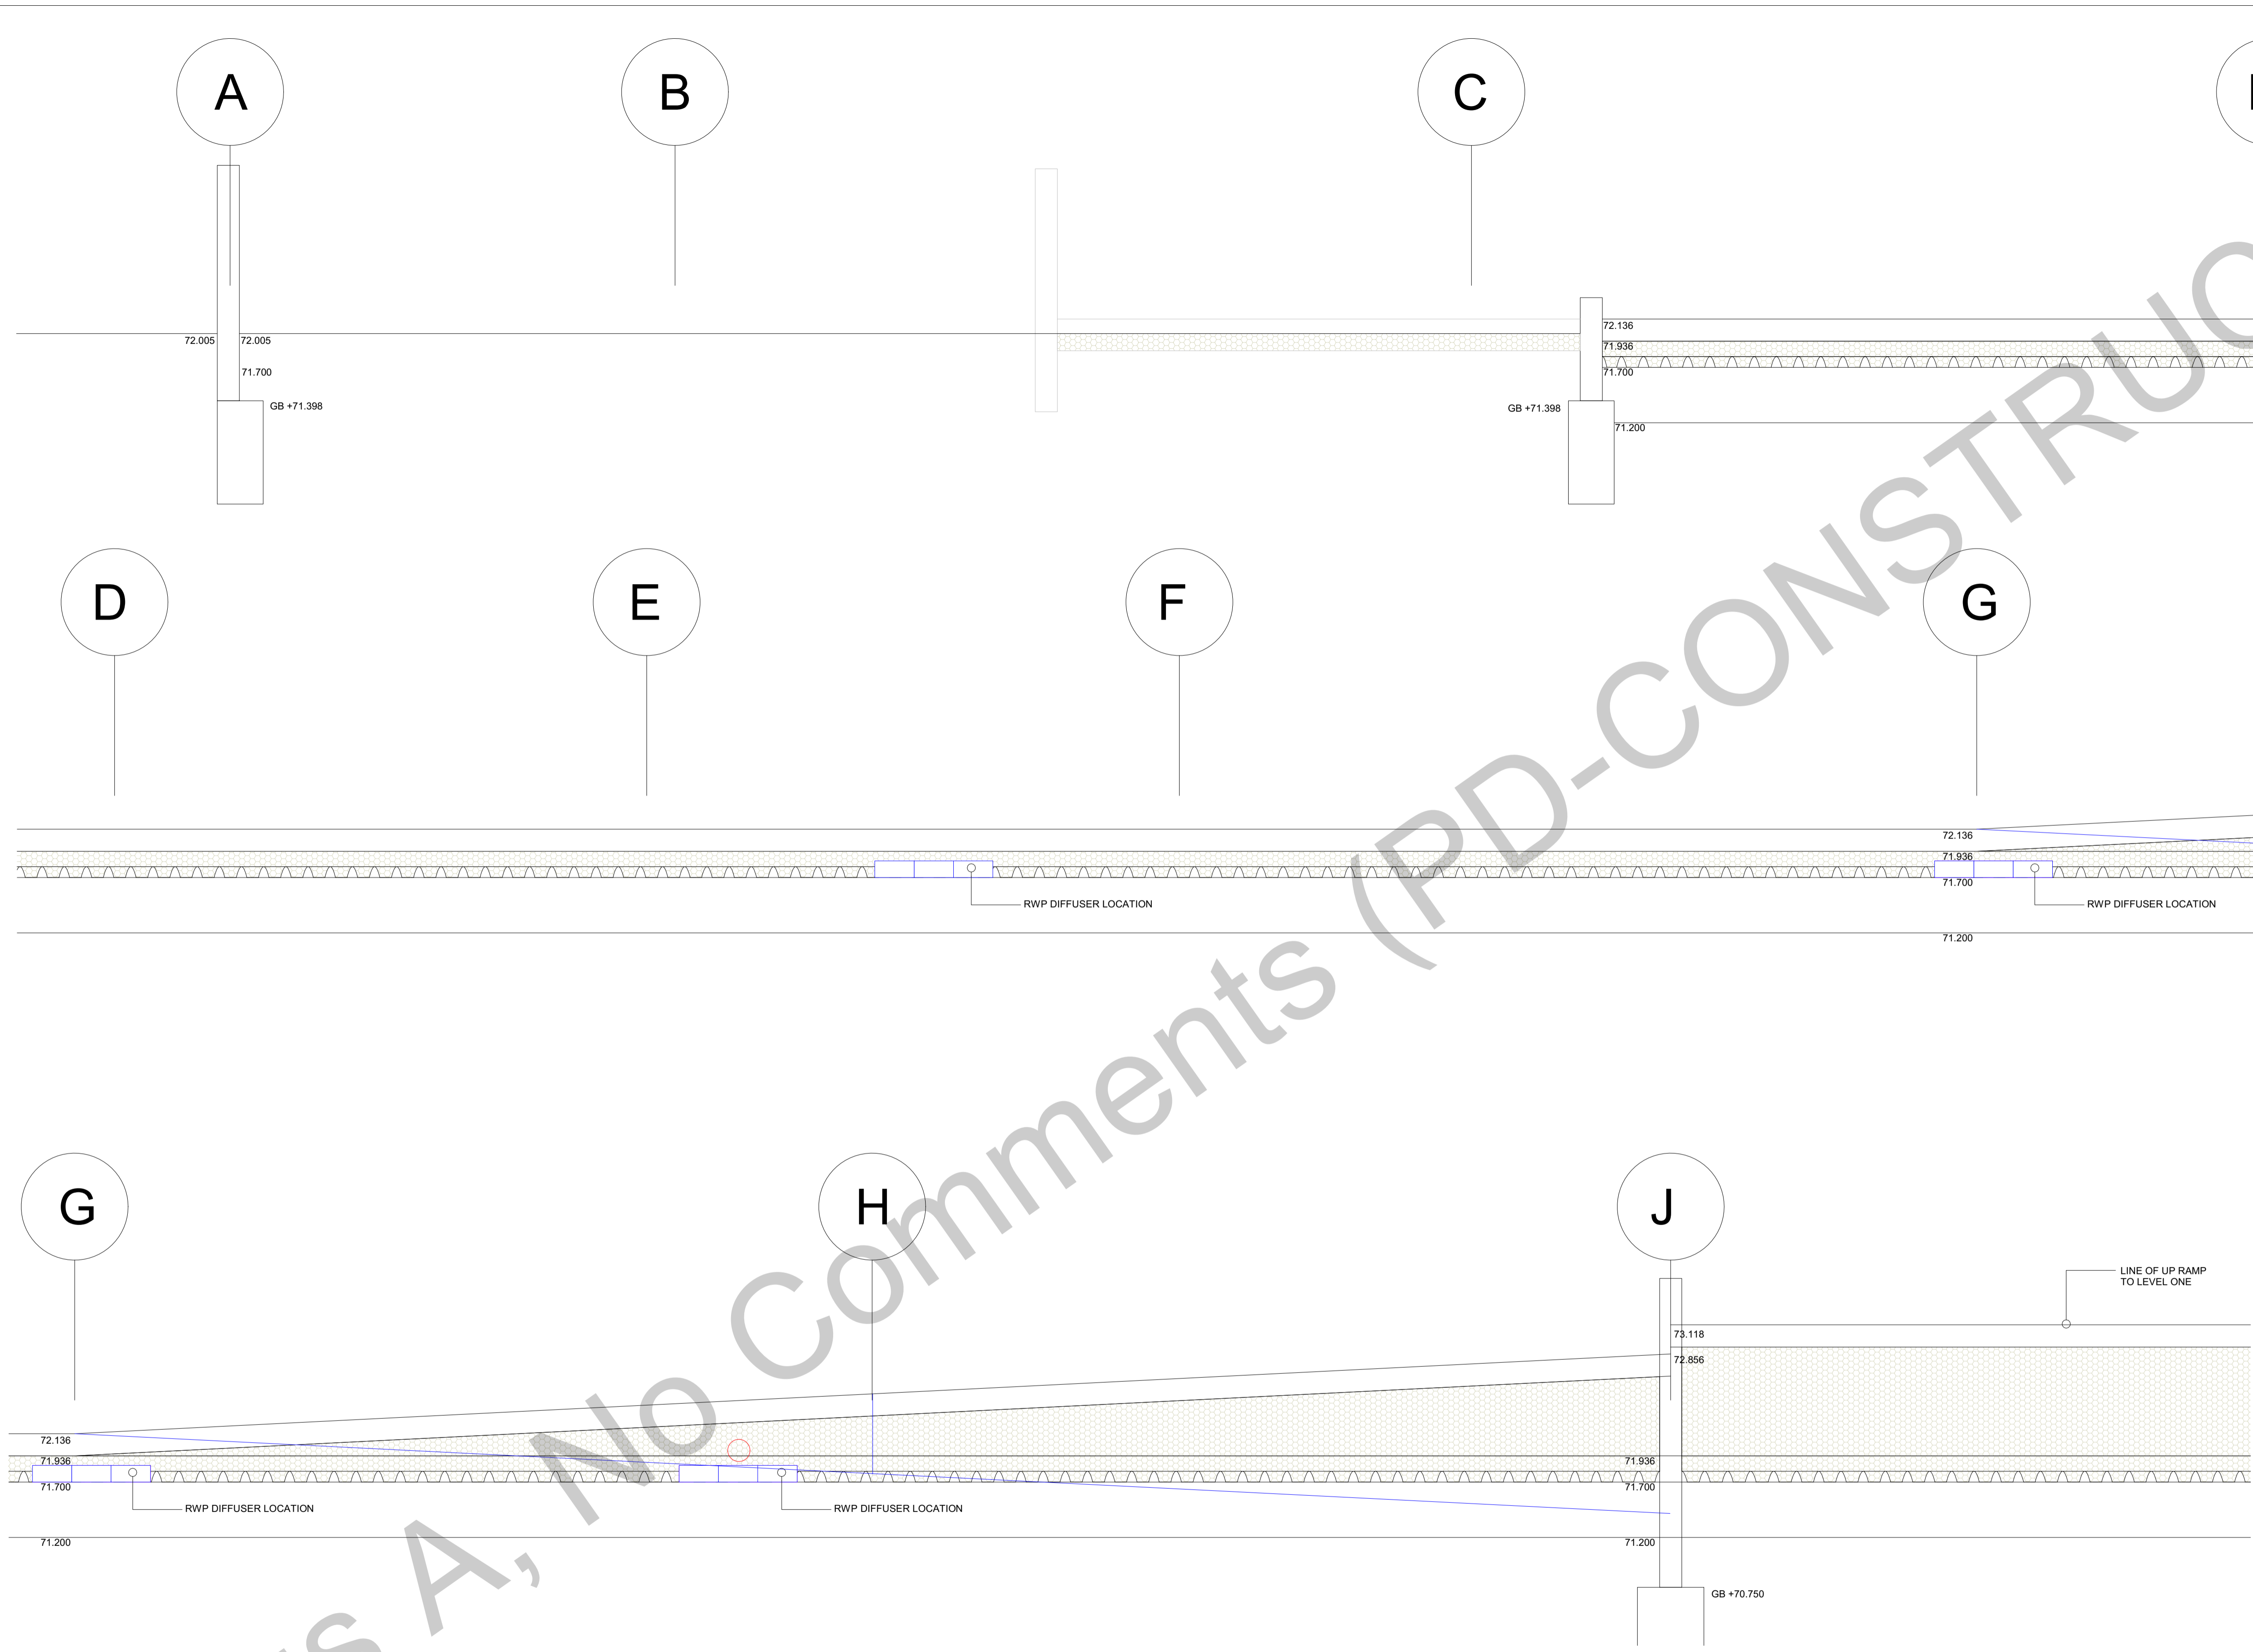

**NOTES**

**GENERAL**  
 This drawing is to be read in conjunction with all relevant Engineers and Architects drawings.  
 For setting out refer to Architects drawings.  
 All dimensions are in millimetres and levels are in metres unless noted otherwise.  
 Contractor to take all relevant dimensions on site.  
 Any discrepancies to be advised to the Engineer.  
 Contractor to check/scan for services prior to construction to avoid any damage during works.

**DRAINAGE**  
 Any information given on this drawing regarding existing services is believed to be correct.  
 The contractor must check this information and determine the nature and location of other existing services from the various statutory authorities before commencing excavation works.  
 Drainage works to be constructed in accordance with BS EN 752 and Approved Document H.  
 All soft spots and unacceptable material encountered in drainage excavations is to be removed and replaced with granular material to the requirements of the building control officer.  
 Pipes to be installed to manufacturers recommendations.  
 Pipes under buildings to be laid to a fall of 1:40 minimum unless noted otherwise.  
 Plastic plain wall pipes to be PVC-U to BS EN 1401-1, class SN4, with flexible joints, Kitemark certified. Structured wall plastic pipes to be to WIS 04-35-01, Kitemark certified.  
 Clay pipes to be vitrified clay to BS EN 285-1, with flexible joints, Kitemark certified. Clayware pipes must be extra strength classification protected in accordance with the specified details.  
 Bedding of pipes to be in accordance with approved document H1.  
 Rocker pipes with flexible joints are to be provided at a distance of 150mm and 750mm from the face of construction to manholes, where pipes pass above, below or through ground beams or foundations; at gully connections and soil stack ends.  
 Manhole access covers are to be located at the outgoing side of manholes.  
 Cover levels are to be fixed on site to suit finished levels. Covers and frames to BS EN124, Grade D to be used in areas subject to heavy vehicular loading, Grade C in areas subject to light vehicular loading and Grade B to be used elsewhere.

REV.	DESCRIPTION	DATE	DRW.	CHK.
C02	Conduit beyond G/L 5 removed	31/01/2023	MG	ABS
C01	First issue	18/10/2022	MG	ABS

**NHS**  
**Manchester University**  
 NHS Foundation Trust

**Sel Environmental Ltd**  
 Real Innovation  
 SEL Environmental Ltd  
 Canal House  
 Bonsall Street  
 Blackburn  
 BB2 4DD  
 Tel: 01254 589987  
 www.sel.co.uk


**PROJECT**  
 North Manchester General Hospital

**TITLE**  
 MSCP Surface Water Attenuation  
 Details, sheet 5 of 6

<b>STATUS</b> S4	<b>PURPOSE OF ISSUE</b> For Construction		
<b>DRAWN BY</b> MG	<b>CHECKED BY</b> JS	<b>DATE</b> 18/10/2022	
<b>SCALE (@A1)</b> NTS		<b>PROJECT NUMBER</b> 20200 MSCP	


<b>FILE DRAWING NUMBER</b> 20200-SEL-NM110-EX-DR-Y-0018	<b>REV.</b> C02
--	--------------------

FOR CONTINUATION  
 20200-SEL-NM110-EX-DR-Y-0019

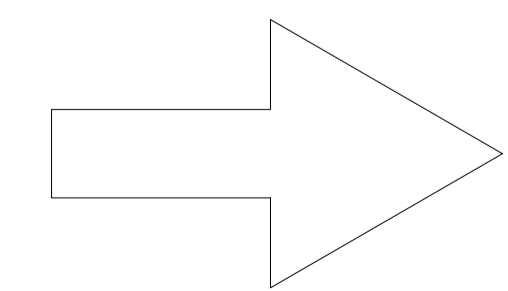

Status A, No Comments



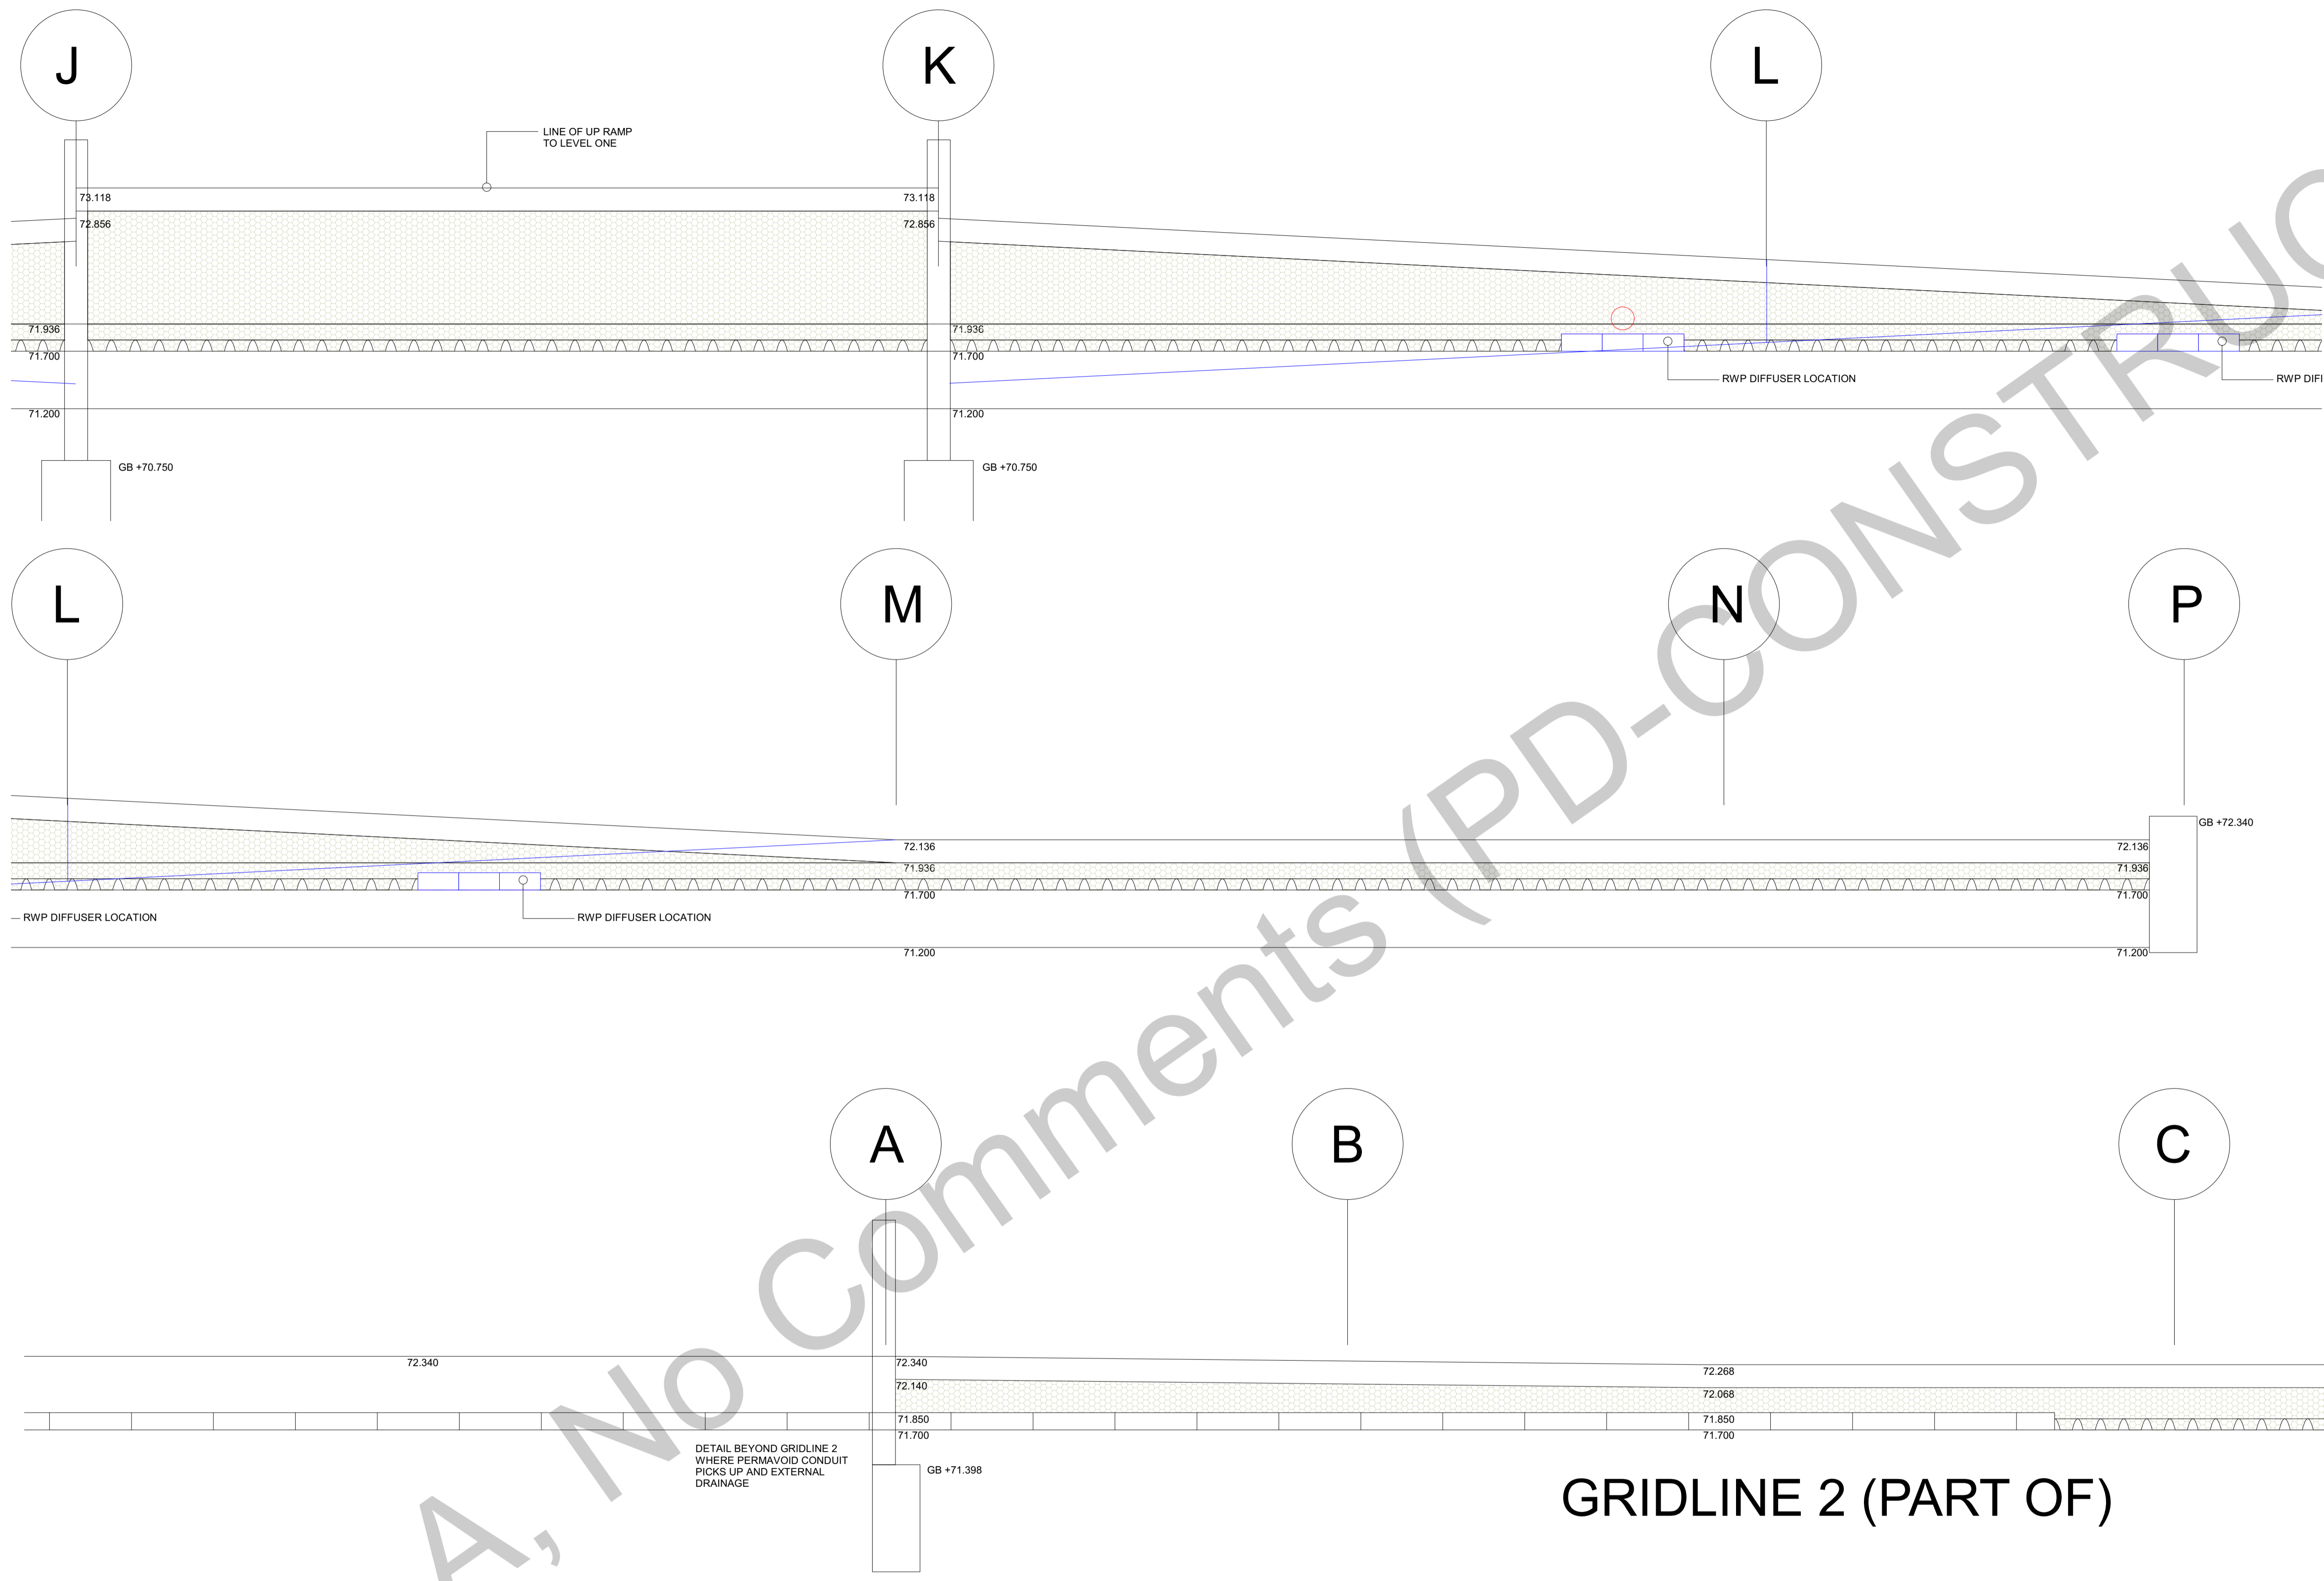

NOTES

GENERAL  
This drawing is to be read in conjunction with all relevant Engineers and Architects drawings.  
For setting out refer to Architects drawings.  
All dimensions are in millimetres and levels are in metres unless noted otherwise.  
Contractor to take all relevant dimensions on site.  
Any discrepancies to be advised to the Engineer.  
Contractor to check/scan for services prior to construction to avoid any damage during works.

DRAINAGE  
Any information given on this drawing regarding existing services is believed to be correct.  
The contractor must check this information and determine the nature and location of other existing services from the various statutory authorities before commencing excavation works.  
Drainage works to be constructed in accordance with BS EN 752 and Approved Document H.  
All soft spots and unacceptable material encountered in drainage excavations is to be removed and replaced with granular material to the requirements of the building control officer.  
Pipes to be installed to manufacturers recommendations.  
Pipes under buildings to be laid to a fall of 1:40 minimum unless noted otherwise.  
Plastic plain wall pipes to be PVC-U to BS EN 1401-1, class SN4, with flexible joints, Kitemark certified. Structured wall plastic pipes to be to WIS 04-35-01, Kitemark certified.  
Clay pipes to be vitrified clay to BS EN 285-1, with flexible joints, Kitemark certified. Clayware pipes must be extra strength classification protected in accordance with the specified details.  
Bedding of pipes to be in accordance with approved document H1.  
Rocker pipes with flexible joints are to be provided at a distance of 150mm and 750mm from the face of construction to manholes, where pipes pass above, below or through ground beams or foundations; at gully connections and soil stack ends.  
Manhole access covers are to be located at the outgoing side of manholes.  
Cover levels are to be fixed on site to suit finished levels. Covers and frames to BS EN124, Grade D to be used in areas subject to heavy vehicular loading, Grade C in areas subject to light vehicular loading and Grade B to be used elsewhere.

REV.	DESCRIPTION	DATE	DRW.	CHK.
C01	First issue	18/10/2022	MG	ABS

**NHS**  
Manchester University  
NHS Foundation Trust

**Sel Environmental Ltd**  
Real Innovation  
SEL Environmental Ltd  
Canal House  
Bonsall Street  
Blackburn  
BB2 4DD  
Tel: 01254 589987  
www.selel.co.uk

PROJECT North Manchester General Hospital	
TITLE MSCP Surface Water Attenuation Details, sheet 6 of 6	
STATUS S4	PURPOSE OF ISSUE For Construction
DRAWN BY MG	CHECKED BY JS
DATE 18/10/2022	
SCALE (@A1) NTS	PROJECT NUMBER 20200 MSCP
FILE DRAWING NUMBER 20200-SEL-NM110-EX-DR-Y-0019	REV. C01

FOR CONTINUATION  
20200-SEL-NM110-EX-DR-Y-0018

GRIDLINE 2 (PART OF)